


SECTION

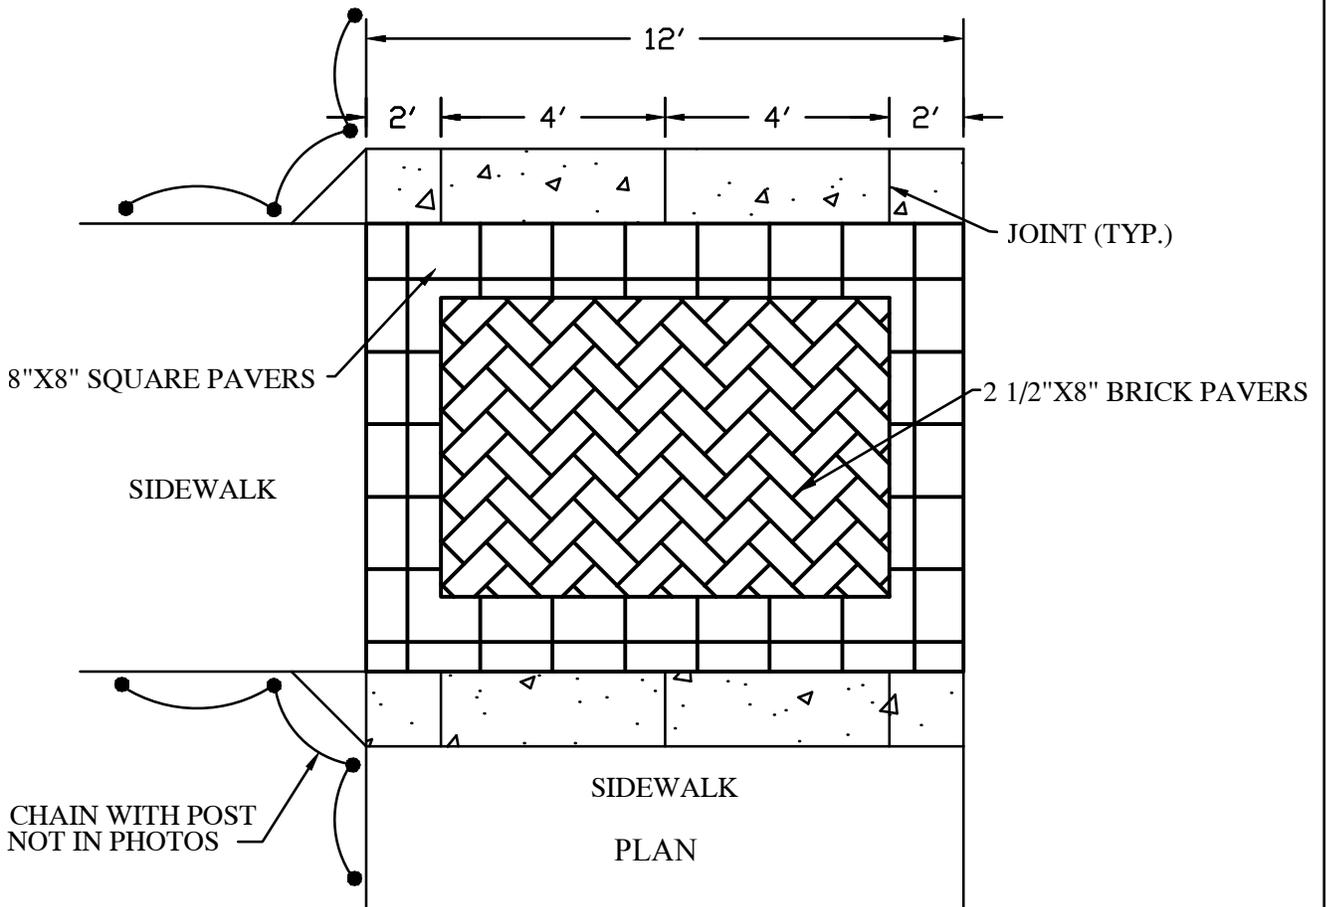

NOTES:

- 1) Primary walks shall be 12' wide, measured inside clear area on ramps.
- 2) All walks wider than 8' must be reinforced.
- 3) Concrete to be class A3.
- 4) Color patterns with university approval.

NTS

Date: 6-3-2013



PRIMARY WALK SECTION AND PLAN

Detail No: 3.1-9